



BASE REQUIREMENTS

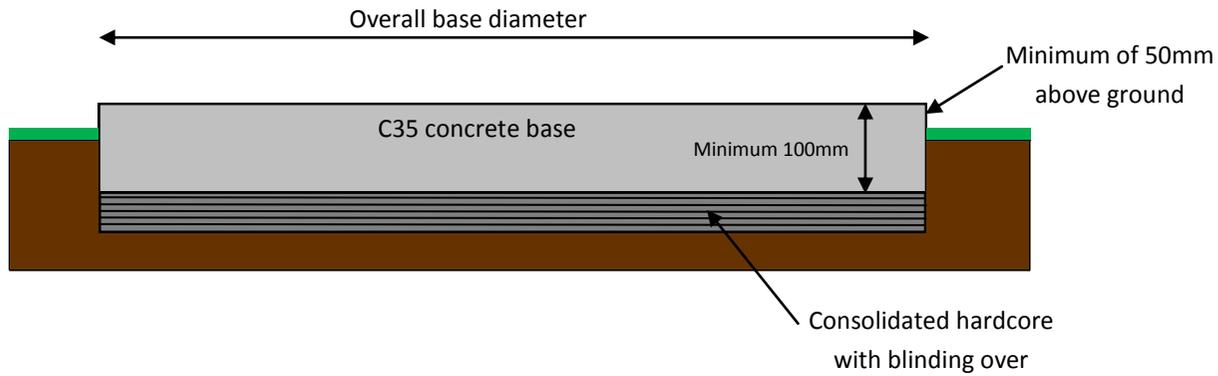

Ground preparation

Prior to pouring the concrete slab, we recommend the following procedure:

- Excavate top soil down to sub soil level
- Roll or compact sub soil prior to introduction of hardcore
- Introduce minimum 150mm hardcore and compact
- Apply minimum 50mm blinding
- Minimum 100mm C35 concrete (reinforce where necessary)

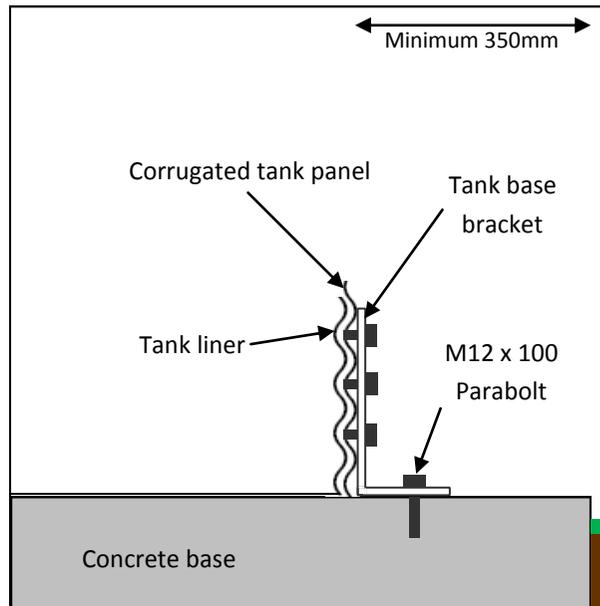

	Tank Diameter	Base Slab Diameter	Volume m ³
DWT-FTK24-4	7360mm	8060mm	130
DWT-FTK24-6	7360mm	8060mm	194
DWT-FTK36-4	11042mm	11742mm	297
DWT-FTK36-6	11042mm	11742mm	442
DWT-FTK48-4	14722mm	15422mm	528
DWT-FTK48-6	14722mm	15422mm	787